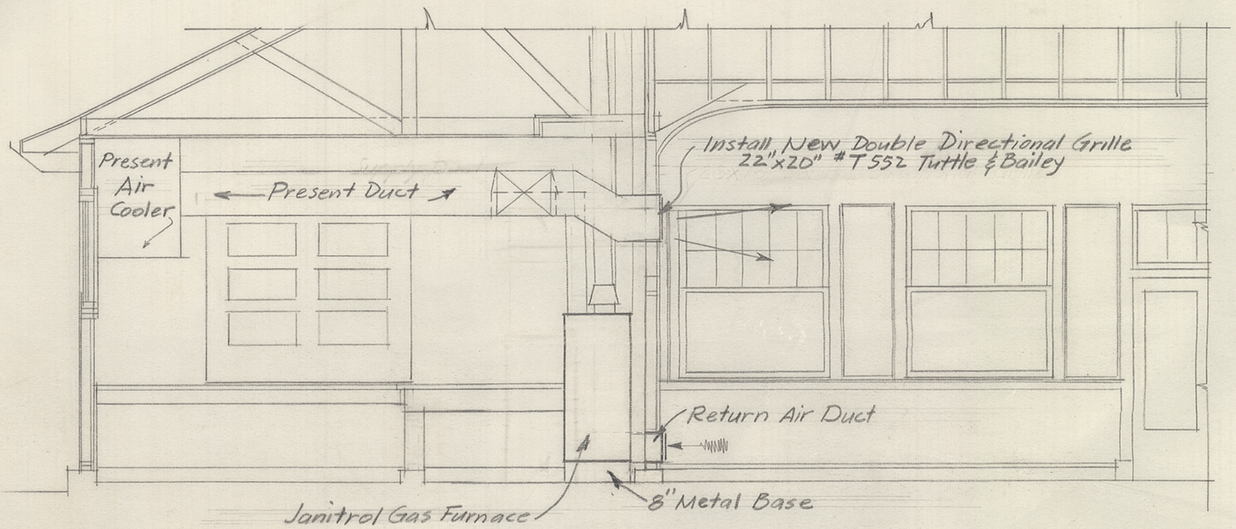
Present Air Cooler
Present Duct
Install, New, Double Directional Grille 22"x20" # T 552 Tuttle & Bailey
Return Air Duct
Janitrol Gas Furnace
8" Metal Base

Section

Scale: 1/4" = 1'-0"

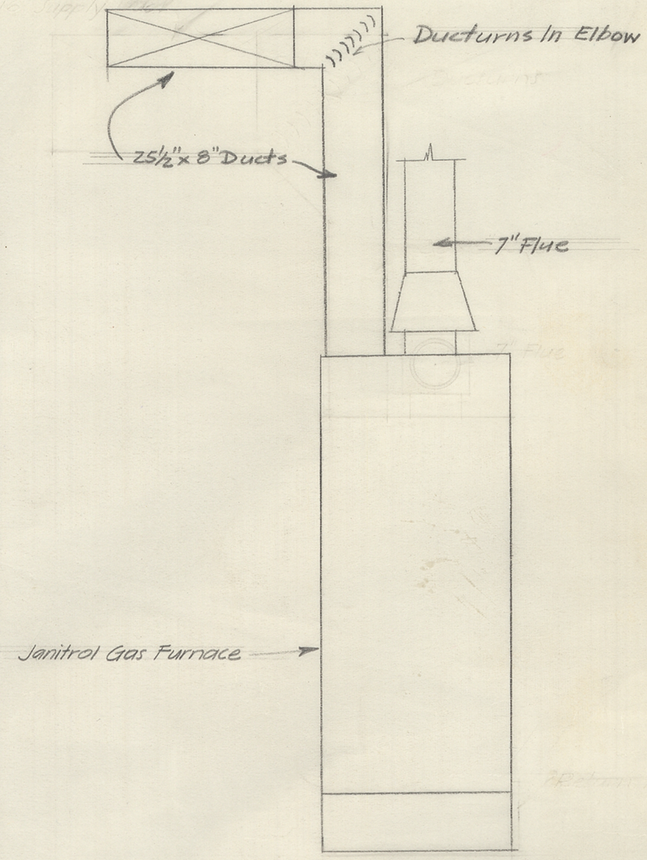

Detail Of Furnace

Scale: 3/4" = 1'-0"

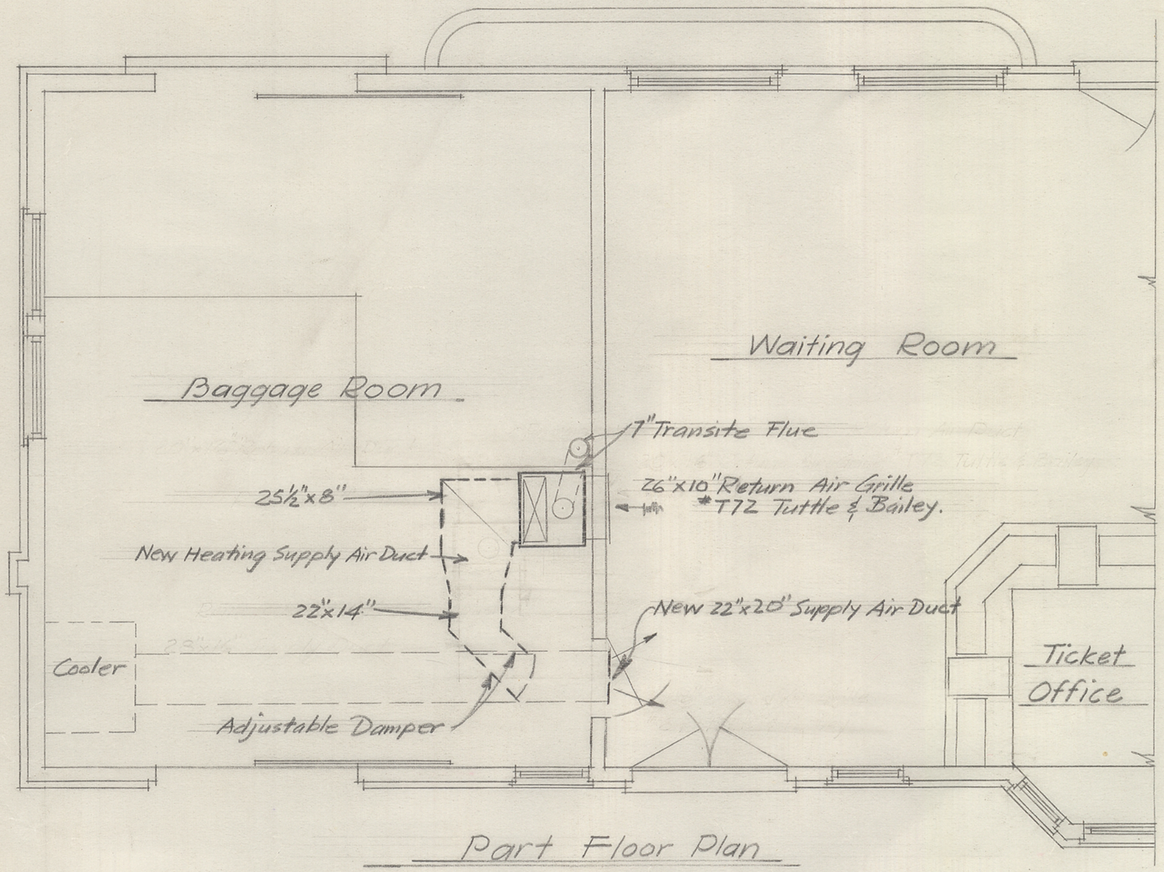

Part Floor Plan

Scale: 1/4" = 1'-0"

Note:

FEC 120 - 84K Janitrol Gas Fired Furnace With Air Filters 120,000 B.t.u. Input 86,400 B.t.u. Output 1050 C.f.m. ½ H.P.
Duct Of 24 Ga. Galv. Steel With 1" Standing Seams And Covered With 1" Fiberglass Coated Duct Insulation.
1" Gas Pipe Main Required.

SOUTHERN PACIFIC CO.
PASSENGER STATION
REDDING, CALIFORNIA.
PROPOSED HEATING DIAGRAM
PLAN, SECTION, & DETAILS

Scale Noted. K.M. 3/6/53
Rev. 4/7/53 K.M.

M.W.D.
Drawing 572
Sheet M-1
Drawer 40